

Annexure-C

SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No...S.6.1..... / प्रयोगशाला / २१


Date: 30-09-2026

It is certified that team headed by SAURABH KUMAR (CHEMIST) from DISTRICT WATER ANALYSIS LABORATORY, U.P. JAL NIGAM (RURAL), ETAH inspected the TRIVENI DEVI PUBLIC SCHOOL on 29/09/2026 and on the basis of Water Test Report (Attached) bearing no- Etah/2026/353 dated 01/10/2026 of DISTRICT WATER ANALYSIS LABORATORY, U.P. JAL NIGAM (RURAL), ETAH certified that the TRIVENI DEVI PUBLIC SCHOOL, ETAH has safe drinking water facilities for the students and staff of the institution.

This certificate is valid till ...01/03/2027

Signature with Seal:

Name : Er. Nikhil Kulshreshtha
Designation : Assistant Engineer
Name & Address of the office
/Department: U.P. JAL NIGAM (RURAL)
ETAH (U.P.)

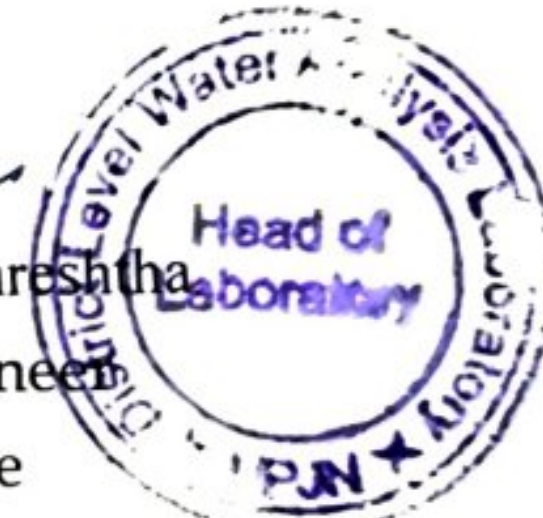

To
TRIVENI DEVI PUBLIC SCHOOL
ALIGANJ ETAH



कार्यालय अधिशासी अभियन्ता

खण्ड कार्यालय, उ०प्र० जल निगम (ग्रामीण), एटा

गली-01 संगम विहार कॉलोनी, निकट महाराणा प्रताप चौक, एटा

दूरभाष +91 7895130209, ई-मेल eeupjnetahrural@gmail.com & upjnretah@upjnco.in

पत्रांक:- 561

सेवा में,

प्रबन्धक,

T.D PUBLIC SCHOOL

ETAH.

/ प्रयोगशाला / 21

दिनांक:- 30-09-2026

विषय- जल नमूना जाच रिपोर्ट के सम्बन्ध में।

महोदय,

उपरोक्त विषयक आप द्वारा लिखित पत्र दिनांक 29.09.2026 के क्रम में आपके द्वारा T.D PUBLIC SCHOOL ETAH. हेतु जनपदीय प्रयोगशाला एटा में जमा कराये जल नमूना की जांच की गयी जो कि मानक के अनुरूप है।

अतः समर सेविल का पानी प्रयोग हेतु उपयुक्त है।

संलग्नक- उपरोक्तानुसार।

भवदीय,

अधिशासी अभियन्ता



District Level Water Analysis Laboratory

Uttar Pradesh Jal Nigam (Rural), Etah


Test Report

Report Issue Date	01.10.2026		
Letter No.		Date-	29.09.2026
Customer Name and Address	T.D Public School Etah		
Report No.	Etah/2026/353		
Sampling Method ISO 17614 (Part – 1):2021			
Sample Description:- Liquid transparent and colourless liquid received at ambient condition.			
Basic Details of Sample			
Address :- T.D Public School Etah			
Water Source	SUBMERSIBLE	Sample ID	Etah/2026/353
Sample Collector	Sample collected by School	Date of sampling.	29.09.2026
Depositor	LAB TECHNICIAN	Receiving Date	29.09.2026
Packaging Type	Glass Bottle	Analysis Start Date	29.09.2026
Analysis Completion Date	01.10.2026		

Technical Data of Analysis						
SR. NO.	Analysed parameters	Unit	Observed Value	Specified Values as per BIS-10500:2012		Ref. Method of Analysis
				Acceptable Limit	Permissible Limit	
1	pH (at 27°C)*	-	7.94	6.5-8.5	6.5-8.5	IS 3025 (Part 11): 2022 (Electrometric Method)
2	Turbidity*	(NTU)	2.231	1.00	5.00	IS 3025 (Part 10): 2023(Nephelometric Method)
3	TDS*	(mg/L)	366	500	2000	IS 3025 (Part 16): 2023(Gravimetric Method)
4	Chloride*	(mg/L)	35	250	1000	IS 3025 (Part 32): 2019 (Argentometric Method)
5	Total Alkalinity*	(mg/L)	280	200	600	IS 3025 (Part 23): 2023 (Indicator Method)
6	Fluoride*	(mg/L)	0.399	1	1.5	APHA 24 th Edition-4500-F Method C (Electrode Method) : 2023
7	Total Hardness*	(mg/L)	220	200	600	IS 3025(Part 21):2023 (EDTA Method)
8	Calcium*	(mg/L)	108	75	200	IS 3025(Part 40):2024 (EDTA Titrimetric Method)
9	Magnesium*	(mg/L)	39.3	30	100	IS 3025(Part46):2023
10	Sulphate*	(mg/L)	18.97	200	400	APHA 24th Edition -4500-SO4 Method F : 2023
11	Iron*	(mg/L)	0.12	0.3	1.0	APHA 24th Edition – 3500-Fe Method B (Phenanthroline Method):2023
12	Nitrate*	(mg/L)	10.18	45	No Relaxation	APHA 24th Edition -4500- NO3 Method B (UV Screening Method): 2023
13	Colour*	Hazen	5	5	15	IS 3025(Part 4):2023(Platinum Cobalt Visual Comparison Method)
14.	Total Coliform	CFU/100 ml	0	Shall not be detectable in any 100 ml sample	No Relaxation	MFT
15.	E.Coli	CFU/100 ml	0	Shall not be detectable in any 100 ml sample	No Relaxation	MFT

.....End Of Report.....

Prepared by:

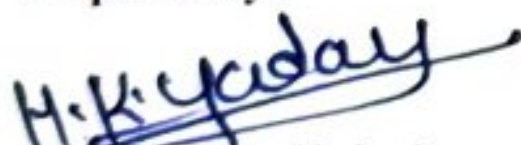
(Harendra Kumar Yadav)
Deputy Technical Manager



Note:-

1. Refers only to the particular sample(s) submitted for testing.
2. This certificate shall not be reproduced, except in full, unless written permission for the publication of an approved abstract has been obtained from Head of Laboratory.
3. The test results reported in this certificate are valid at the time of and under the stated conditions of measurements.
4. Sample will be stored up to 07 days (in case of non-perishable items only) from the date of issue of tests reports unless otherwise specified.
5. Source is not verified by the Laboratory.